


NOTE: STANDARD POLE # TO BE ASSIGNED BY CITY OF BREMERTON ENGINEERING DIVISION



LUMINAIRE POLE SCHEDULE							
STATION	STANDARD NUMBER	POLE HEIGHT	BASE TYPE	MAST ARM LENGTH	VOLTAGE	WATTAGE	DISTRIBUTION & CKT #
0+33L	801 SAMP	40		12		250	M-C-III
1+22L	789 SAMP	40		12		250	M-C-III
2+18L	765 SAMP	40		12		250	M-C-III
3+18L	743 SAMP	40		12		250	M-C-III

CONDUIT WIRING SCHEDULE					
RUN	CONDUIT SIZE	ILLUM.	GROUND	SERVICE	NOTES
1	1" RMC				
2	3/4" PVC		1 #6	3 #6	THHW
3	1 1/2" PVC		1 #8		
4	1 1/2" PVC	2 #8	1 #8		
5	1 1/2" PVC	2 #8	1 #8		
6	2" PVC	2 #8	1 #8		PULL STRING ONLY

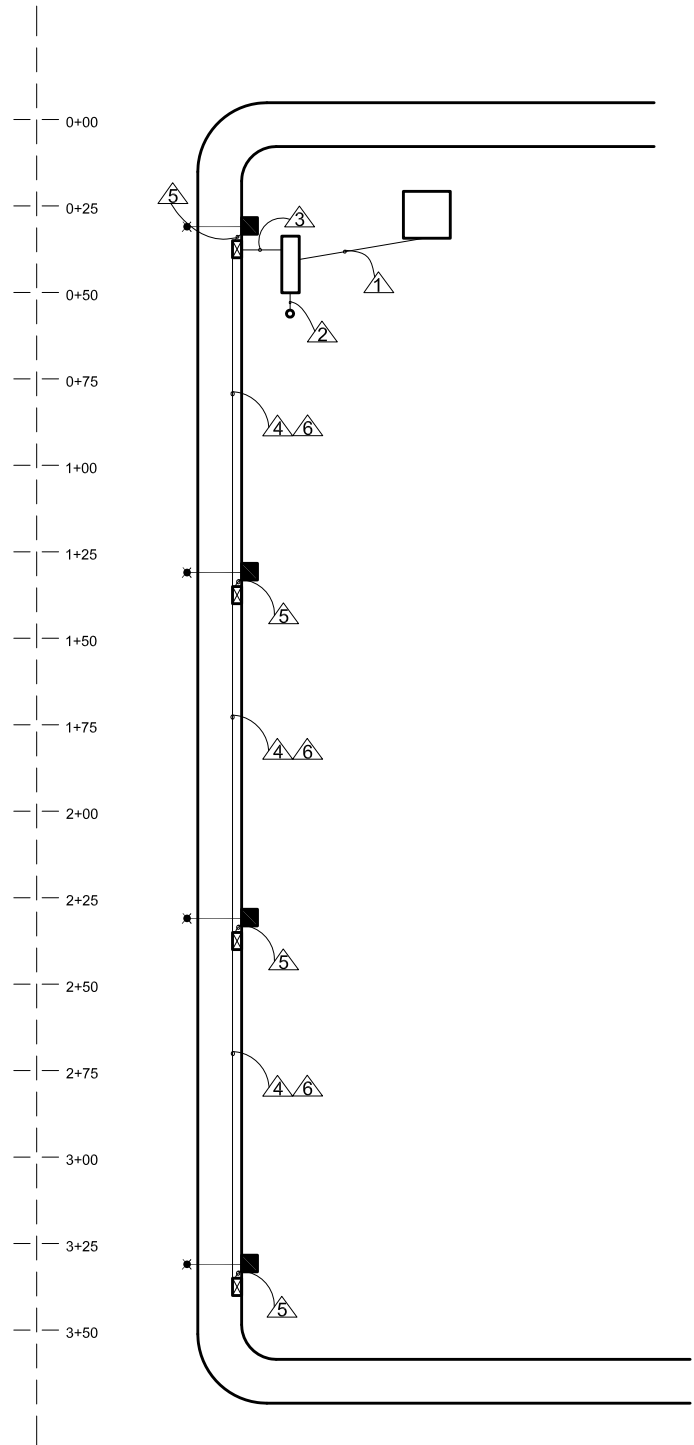

City of Bremerton

PUBLIC WORKS

ENGINEERING DIVISION

**FORMAT FOR SUBMITTAL DRAWINGS
SAMPLE STREET LIGHTING PLAN**

Alteration of this drawing is prohibited. Any approval of an altered drawing is unauthorized and void.

7008

Revision Date
8/22/08